


(CONTRACTOR TO PROVIDE METER VAULT AND INSTALL PIPING TO ACCOMODATE METER ASSEMBLY DIMENSIONS SHOWN)

METER SIZE CONFIGURATION	HP-PROTECTUS METER						
	DIM. "A" FLG. TO FLG. WITH REDUCERS	DIM. "B" FLG. TO FLG. WITHOUT REDUCERS	DIM. "C" METER & STRAINER	DIM. "D" TAILPIECE	DIM. "E" METER WIDTH (SEE NOTE 7 BELOW)	DIM. "F" DISTANCE TO NEAREST OBSTRUCTION (SEE BELOW)	DIM. "G" LENGTH OF FLG. X FLG. REDUCER (SEE BELOW)
4" LINE x 3" METER (4x3)	NA	NA	NA	NA	NA	NA	7" (4"x3" Red.)
4" LINE x 4" METER (4x4)	NA	51"	33"	16"	30 1/2"	18"	
6" LINE x 4" METER (6x4)	65"	NA	33"	12"	39"	18"	9" (6"x4" Red.)
6" LINE x 6" METER (6x6)	NA	65"	45"	18"	39"	18"	
8" LINE x 4" METER (8x4)	81"	NA	33"	24"	43 1/2"	24"	11" (8"x4" Red.)
8" LINE x 6" METER (8x6)	81"	NA	45"	12"	43 1/2"	24"	11" (8"x4" Red.)
8" LINE x 8" METER (8x8)	NA	81"	53"	26"	43 1/2"	24"	
10" LINE x 6" METER (10x6)	91"	NA	45"	20"	45"	24"	12" (10"x6" Red.)
10" LINE x 8" METER (10x8)	91"	NA	53"	12"	45"	24"	12" (10"x8" Red.)

- NOTE: 1) ALL DIMENSIONS ARE IN INCHES
 2) REFER TO METER VAULT DETAIL WHICH IS SPECIFIC TO YOUR APPLICATION FOR ADDITIONAL INFORMATION
 3) DIMENSION "A": CONTRACTOR TO SUPPLY METER VAULT WITH THIS DIMENSION BETWEEN FLANGES (WHEN REDUCERS ARE REQUIRED). THIS CLEARANCE WILL ALLOW FUTURE INSTALLATION OF LARGER METER (IF AVAILABLE, UP TO THE SIZE OF THE SUPPLY PIPING IF DESIRED)
 4) DIMENSION "B": CONTRACTOR TO SUPPLY METER VAULT WITH THIS DIMENSION BETWEEN FLANGES WHEN REDUCERS ARE NOT REQUIRED AND METER SIZE IS THE SAME AS THE SUPPLY PIPING INTO THE METER VAULT
 5) DIMENSION "C" IS FOR METER/STRAINER ASSEMBLY SUPPLIED BY SPARTANBURG WATER
 6) DIMENSION "D" INCORPORATES A 2" GAP TO ALLOW FOR GASKET THICKNESS AND TO ALLOW AXIAL MOVEMENT OF THE FLANGE COUPLING ADAPTER DURING ASSEMBLY/DISASSEMBLY
 7) DIMENSION "E" IS FOR USE BY THE CONTRACTOR TO DETERMINE THE WIDTH OF THE METER VAULT NECESSARY TO PROVIDE THE REQUIRED CLEARANCE TO OBSTRUCTIONS AS SHOWN BY DIMENSION "F"
 8) HP-PROTECTUS METERS MAY HAVE THE BYPASS METER LOCATED ON EITHER SIDE OF THE MAIN METER; THEREFORE, PROPER CLEARANCE MUST BE PROVIDED ON EITHER SIDE OF THE METER ASSEMBLY AS SHOWN BELOW.
 9) SPARTANBURG WATER WILL SUPPLY THE FOLLOWING COMPONENTS ONLY:
 THE METER AND STRAINER ASSEMBLY
 THE ROMAC FLANGE COUPLING ADAPTER
 10) THE CONTRACTOR SHALL SUPPLY ALL OTHER COMPONENTS NEEDED FOR THE COMPLETE INSTALLATION. REFER TO THE SPECIFIC DETAIL WHICH APPLIES TO YOUR INSTALLATION.
 11) 8" IS THE LARGEST HP-PROTECTUS METER SUPPLIED BY SPARTANBURG WATER
 12) FOR PROJECTS REQUIRING METERS IN THE 10" AND 12" SIZE, PLEASE CONTACT SPARTANBURG WATER ENGINEERING FOR GUIDANCE

HP-PROTECTUS METER

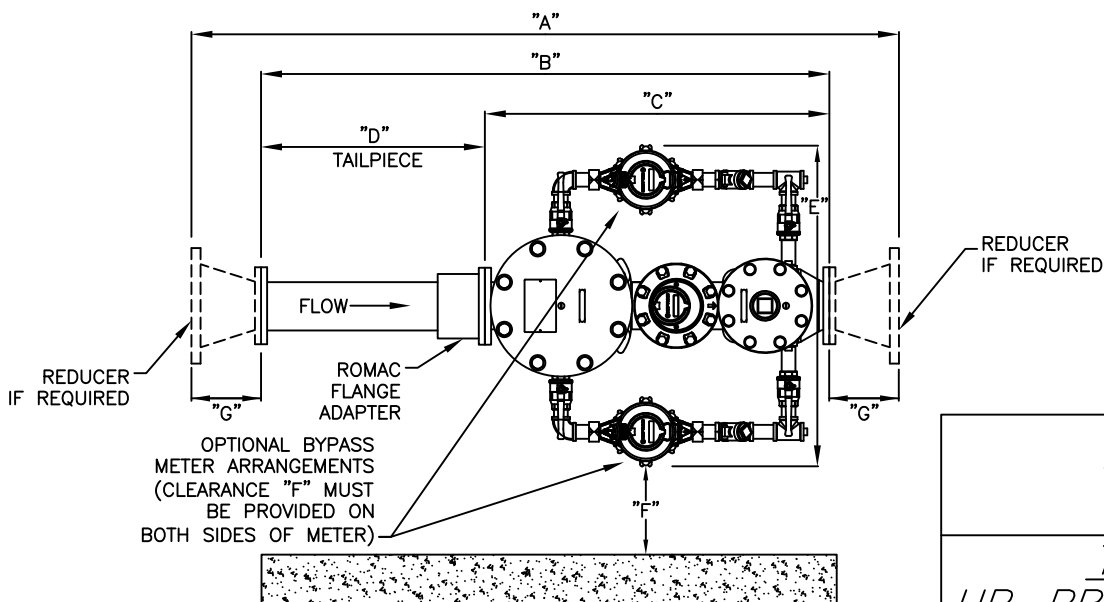

METER DIMENSIONAL DATA
NTS



TABLE 1b:
HP-PROTECTUS METER
PIPING AND VAULT
DIMENSION GUIDELINES

SCALE: NTS REVISION DATE: _____